

BIDS AND AWARDS COMMITTEE (BAC)

*Excerpt from the minutes of the Bids and Awards Committee Meeting
Held at MNWD Conference Room on October 11, 2024*

RESOLUTION NO. 23

Series of 2024

BAC RESOLUTION DECLARING FIRST FAILURE OF BIDDING FOR THE PROJECT SUPPLY, DELIVERY, INSTALLATION, TESTING, AND COMMISSIONING OF PUMP, ELECTRO-MECHANICAL EQUIPMENT, DISCHARGE LINE, ELECTRICAL EQUIPMENT, AND GENERATOR SET OF STA. LUCIA II PUMPING STATION (GOODS 2024-010) AND SUBSEQUENTLY RESCHEDULED REBIDDING FOR THE SAME AND RECOMMENDING APPROVAL BY THE HEAD OF PROCURING ENTITY (HOPE)/CHAIRMAN OF THE BOARD OF DIRECTORS OF METROPOLITAN NAGA WATER DISTRICT (MNWD)

WHEREAS, the Metropolitan Naga Water District (MNWD) Bids and Awards Committee (BAC), through its Secretariat, posted the Invitation to Bid (ITB) for the project **Supply, Delivery, Installation, Testing, and Commissioning of Pump, Electro-Mechanical Equipment, Discharge Line, Electrical Equipment, and Generator Set of Sta. Lucia II Pumping Station (GOODS 2024-010)** in the Philippine Government Electronic Procurement System (PhilGEPS), MNWD Bulletin Board, and MNWD Website on September 9 to 30, 2024, with an Approved Budget for the Contract (ABC) of **THREE MILLION TWO HUNDRED THOUSAND PESOS (Php 3,200,000.00) ONLY. Delivery of the Goods is required within NINETY (90) CALENDAR DAYS.** Pre-bid Conference was conducted last September 16, 2024;

WHEREAS, although five (5) prospective bidders attended during the Pre-Bid Conference, only one (1) bidder submitted bid documents during the Bid Opening of September 30, 2024, namely: (1) **Armen Electro-Mech Sales and General Merchandise**;

WHEREAS, during the Bid Opening on September 30, 2024, the BAC meticulously counter-checked the submitted documents of the bidders concerned against a checklist of required eligibility documents, as indicated in the ITB and the instruction to bidders, to ascertain the bidder's compliance with the requirements using a non-discretionary pass (/) or fail (x) criterion;


WHEREAS, during the Bid Evaluation Report on October 2, 2024, on the detailed examination of bids of the participating bidder, it offers varying brands for each component of the project, particularly in its Electro-Mechanical component, namely, Tormac for the Submersible Deep Well Pump and Motor, Grundfos for the Variable Frequency Drive, HPISD for Soft Starter; as well as in its Generator Set, which is of Hong Fu Brand for the Cummins Engine Generator; CRI Pipes for Riser Pipes; and locally manufactured brands for other project components;

For more information, please contact us:

- ☎ (+63) 928 681 1386 • (+63) 927 463 5974
- 📞 (054) 473 7813 • Local 114
- ✉ mnwaterdistrict@yahoo.com
- 🌐 www.mnwd.gov.ph

A

N 7 8 9 5

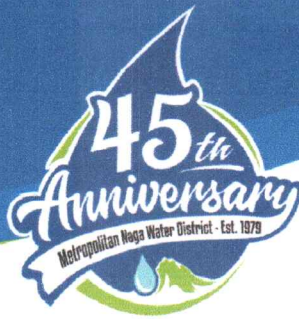


WHEREAS, during the Bid Evaluation of the bid, finding compliance with the eligibility and technical documents, as well as the bid-offer amounting to **THREE MILLION ONE HUNDRED FIFTY THOUSAND PESOS (Php 3,150,000.00) ONLY**, the BAC declared the bid of ARMEN ELECTRO-MECH SALES AND GENERAL MERCHANDISE, as calculated, as the Single Calculated Bid (SCB) for the project Supply, Delivery, Installation, Testing, and Commissioning of Pump, Electro-Mechanical Equipment, Discharge Line, Electrical Equipment, and Generator Set of Sta. Lucia II Pumping Station (GOODS 2024-010) for Metropolitan Naga Water District (MNWD);

WHEREAS, during the review and evaluation of the BAC and TWG of the documents and technical specifications of the bid during the Post Qualification Evaluation, the BAC finds that the offer is **non-responsive** with the requirements stipulated in the Technical Specifications in the Bidding Documents, to wit:

MNWD REQUIREMENT	ARMEN ELECTRO-MECH SALES AND GENERAL MERCHANDISE
<u>PUMP & ELECTRO-MECHANICAL EQUIPMENT</u>	
1. 4" Ø x 3m uPVC Column Pipe , Heavy Type, Square Thread w/ Rubber Seals -Safe Pulling Load with Chain Pulley: 12,000Kgs -Ultimate Breaking Load: 15,500kgs -Safe Allowable Hydrostatic Pressure: 26 kg/cm ²	<p>OFFER: C.R.I uPVC pipes</p> -Safe Pulling Load with Chain Pulley: 8,426 Kgs -Ultimate Breaking Load: 12,000 Kgs
2. GENERATOR SET Prime Rating Power, heavy duty generator, Diesel engine rated at 50 KVA, 460 volts, 3-Phase 60Hz, 1800 rpm. Automatic transfer switch (ATS) compatible, sound proof and water protected canopy, trailer mounted with two wheels with towing bar Technical Data: PRP Continuous Power : 50 KVA / 40 KW Power Factor : 0.8 PF Voltage (VAC) : 460 V Frequency : 60 Hz Speed : 1800 rpm Governor Type : Mechanical Battery : 12 V Combustion System : Direct Injection Fuel : Diesel No. of Cylinder : 6	<p>OFFER: HONGFU WP GEN SET POWERED BY CUMMINS</p> -Prime Power Rating at 45 KVA/ 36 KW -Standby Power : 50 KVA / 40 KW -Rated Voltage Line to Line: 220V/127 -Governor: Electric System -No. of Cylinders: 4

For more information, please contact us:

- ☎ (+63) 928 681 1386 • (+63) 927 463 5974
- 📞 (054) 473 7813 • Local 114
- ✉ mnwaterdistrict@yahoo.com
- 🌐 www.mnwd.gov.ph

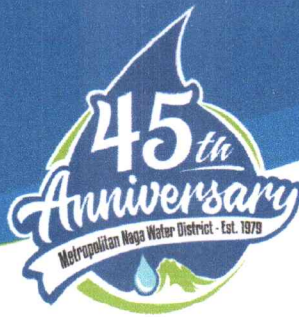

Induction System : Turbocharged, air to air charge cooled Cooling System : Water-cooled Insulation System : Class H Type of Excitation : Shunt Type of Regulation : AVR Voltage Regulation (Steady) : ± 5% Warranty: 2000 running hours/ 24 months	-ATS Compatibility is not included in standard features -Warranty: 1000 running hours/12 months NON-COMPLIANT
3. 4" Ø Flow Meter	No Brochure attached to the submitted documents, as such, there is no reference for evaluation.

WHEREAS, with the evaluation of the comparative required technical specifications for major equipment included in the Contract to Bid, the BAC finds **Armen Electro-Mech Sales and General Merchandise** to be **non-responsive** to the requirements stipulated in the Technical Specifications in the Bidding Documents, as such declaring the bidder disqualified for its failure to pass the post qualification evaluation;

WHEREAS, the BAC declared the First Failure of Bidding for the project Supply, Delivery, Installation, Testing, and Commissioning of Pump, Electro-Mechanical Equipment, Discharge Line, Electrical Equipment, and Generator Set of Sta. Lucia II Pumping Station (GOODS 2024-010);

NOW THEREFORE, we, the Members of the Bids and Award Committee, hereby, **RESOLVE**, as it is hereby, **RESOLVED**:


1. To declare the First Failure of Bidding for the project **Supply, Delivery, Installation, Testing, and Commissioning of Pump, Electro-Mechanical Equipment, Discharge Line, Electrical Equipment, and Generator Set of Sta. Lucia II Pumping Station (GOODS 2024-010)** and subsequent rebidding; and,
2. To recommend approval by the Head of the Procuring Entity (HOPE)/Chairman of the Board of Directors of MNWD for the foregoing findings.

RESOLVED at the MNWD Conference Room, this 11th day of October, 2024.


JON LOUIE A. SANCHEZ
 BAC Chairperson


For more information, please contact us:

- ☎ (+63) 928 681 1386 • (+63) 927 463 5974
- 📞 (054) 473 7813 • Local 114
- ✉ mnwaterdistrict@yahoo.com
- 🌐 www.mnwd.gov.ph

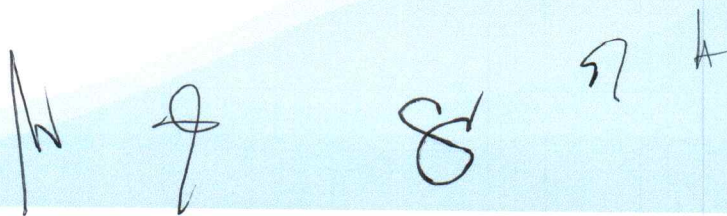


Republic of the Philippines
**METROPOLITAN NAGA
WATER DISTRICT (MNWD)**


40 Miranda Avenue, Concepcion Pequeña
Naga City, Camarines Sur 4400

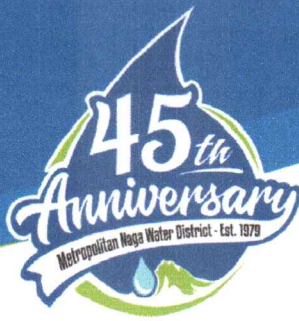


ARTURO M. MARCO
Vice-Chairperson



MELVIN B. MACARAIG
Regular Member


VIRGINIA I. NERO
Regular Member






NOEL A. MARTINEZ, JR.
Regular Member

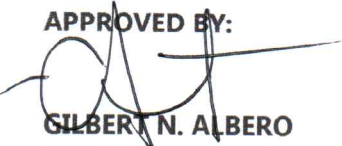
SONJUN O. MILLARES
Provisional Member

APPROVED BY:


GILBERT N. ALBERO
Head of Procuring Entity (HOPE)/
Chairman of the Board of Directors
Date: 10/17/24

For more information, please contact us:

 (+63) 928 681 1386 • (+63) 927 463 5974
 (054) 473 7813 • Local 114
 mnwaterdistrict@yahoo.com
 www.mnwd.gov.ph