


Republic of the Philippines
METROPOLITAN NAGA WATER DISTRICT
 40 J. Miranda Avenue, Naga City
 Telephone Number: (054) 472-1685/473-7813
 Fax Number: (054) 473-9288
 E-mail Add.: mnwdbac@yahoo.com

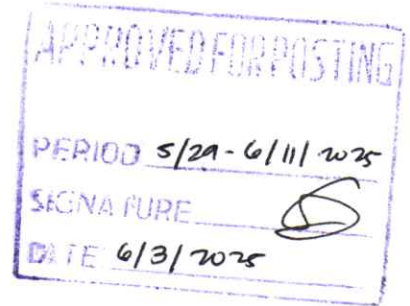

SUPPLEMENTAL/BID BULLETIN
May 29, 2025

ADDENDUM NO. 05

PROJECT: SUPPLY, DELIVERY, INSTALLATION AND COMMISSIONING OF BRAND-NEW ELECTROMAGNETIC FLOWMETER WITH FLOW AND PRESSURE DATA LOGGER (GOODS 2025-005)

This addendum is issued to modify or amend the items in Section VII. Technical Specifications of the bidding documents posted at the PhilGEPS Website of the above-stated project due to typographical error, to wit:

PER PHILGEPS POSTING	PER ADDENDUM
<p>Section VII. Technical Specification</p> <p>Item No. 1</p> <p>DN150 Electromagnetic Flowmeter, 13 units -Power source: 100 to 220 VAC 60 Hz/24 VDC -Signal output: 1 current output, 2 Digital outputs, HART -Cable length: 20 meters -Sensor IP Rating: IP68 -Sensor size: DN150 - Pressure rating: EN1092-1-PN16 - Calibration type: 0.4% - Liner material: Hard rubber - Process connection material: carbon steel</p> <p><u>Inclusion:</u> a. 1 set of Bolts, nuts and gaskets b. 1 pc. of 10m. Power cable c. 1 set of signal conduit d. 1 set of flow and pressure data logger for each flowmeter (refer to item no. 2 for specifications)</p>	<p>Section VII. Technical Specifications</p> <p>Item No. 1</p> <p>DN150 Electromagnetic Flowmeter, 13 units -Power source: 100 to 220 VAC 60 Hz/24 VDC -Signal output: 1 current output, 2 Digital outputs, HART -Cable length: 20 meters -Sensor IP Rating: IP68 -Sensor size: DN150 - Pressure rating: EN1092-1-PN16 - Calibration type: better than $\pm 2\%$ - Liner material: Hard rubber/ NBR - Process connection material: carbon steel</p> <p><u>Inclusion:</u> a. 1 set of Bolts, nuts and gaskets b. 1 pc. of 10m. Power cable c. 1 set of signal conduit d. 1 set of flow and pressure data logger for each flowmeter (refer to item no. 2 for specifications)</p>
<p>Item No. 2</p> <p>Flow and Pressure Data Logger, 13 units - Transmission option: 4G/3G/2G - Transmission frequency: Down to every 5 minutes</p>	<p>Item No. 2</p> <p>Flow and Pressure Data Logger, 13 units - Transmission option: 4G/3G/2G - Transmission frequency: Down to every 5 minutes</p>

<ul style="list-style-type: none">- Direct connection: Bluetooth via mobile phone app- Memory size: 4GB- Data types: Average, minimum, maximum, standard deviation- Sample intervals: 1 minute, 5-minute, 15-minute average, 24-hour totals- Max pulse frequency: 1000Hz- Logging modes: flow rate or volume- Internal pressure range: 0 to 20 Bar- Pressure accuracy: $\pm 0.1\%$ of full range <p><u>Material:</u> Extruded aluminum</p> <p><u>Inclusion:</u></p> <ul style="list-style-type: none">a. 1 pc of 20-m signal cable (for flow)b. 1 pc of pressure hosec. 1 pc of external antennad. 1 set of sim card with 1 year worth of data <p><u>Note:</u></p> <ul style="list-style-type: none">1. Transfer of Technology2. Supplier shall submit OIML / WRAS Certification of the Flowmeters being offered3. Manufacturer's Calibration Certificate	<ul style="list-style-type: none">- Direct connection: Bluetooth via mobile phone app- Memory size: 4GB- Data types: Average, minimum, maximum, standard deviation- Sample intervals: 1 minute, 5-minute, 15-minute average, 24-hour totals- Max pulse frequency: 1000Hz- Logging modes: flow rate or volume- Internal pressure range: 0 to 20 Bar- Pressure accuracy: $\pm 0.1\%$ of full range <p><u>Material:</u> Extruded aluminum / Plastic</p> <p><u>Inclusion:</u></p> <ul style="list-style-type: none">a. 1 pc of 20-m signal cable (for flow)b. 1 pc of pressure hosec. 1 pc of external antennad. 1 set of sim card with 1 year worth of data <p><u>Note:</u></p> <ul style="list-style-type: none">1. Transfer of Technology (for winning bidder only)2. Supplier shall submit OIML or ISO 4064 and WRAS Certification of the Flowmeters being offered3. Manufacturer's Calibration Certificate (for winning bidder only)
--	---

This shall form an integral part of the Bid Documents.

For guidance and information of all concerned.


JON LOUIE A. SANCHEZ
Chairperson, BAC

Received by the Bidder:

(Signature over Printed Name)

Date: _____